


RECENT CASE STUDY:

Case Study King Pin | Energy Efficiency



Project location is Townsville QLD. This example is ideal due to Townsville having year round heat & solar radiation exposure. Strongly demonstrating HVAC reduction due to the Thermoshield coating & BMS installation allowing for a more tailored and reduced energy setting profile.

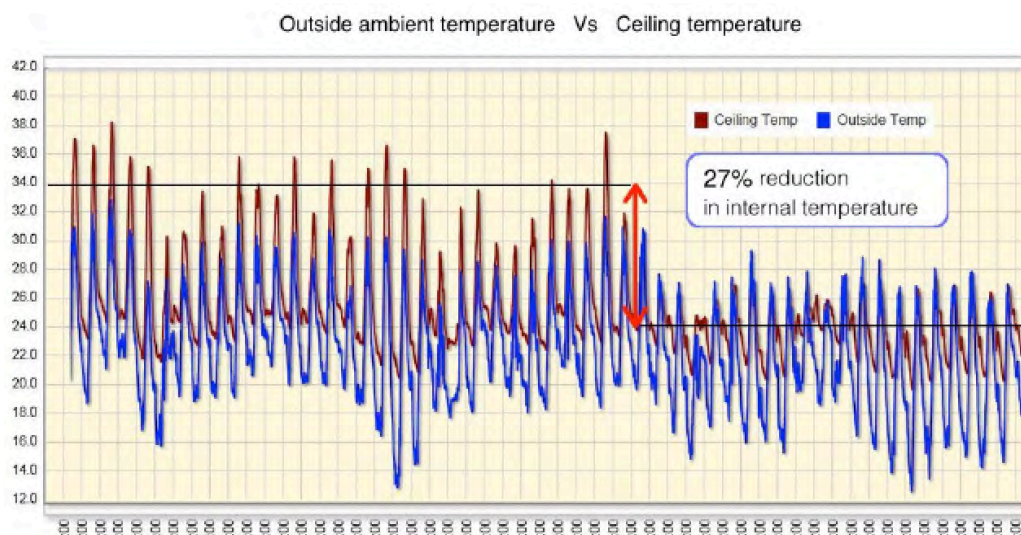

Coating completed in mid June – 2015

July 2014 – 71,372 kWh

July 2015 – 58,246 kWh ... resulting in a **18% total site reduction**

August 2015 – bill unable to be sourced by client

September 2014 – 77,807 kWh

September 2015 – 61,427 kWh ... resulting in a **21% total site reduction**

October bill – not provided as yet

November 2014 – 89,545 kWh

November 2015 – 74,014 kWh ... resulting in a **17.5% total site reduction**